




STSE3F & STSE3G STAINLESS STEEL SUBMERSIBLE CHOPPER PUMPS

Materials of Construction:

Impeller/Upper Cutter/Cutter Nut/Cutter Bar: CD4MCu stainless steel.
 Casing/Backplate: CD4MCu stainless steel.
 Mechanical Seal: Tungsten carbide.
 Flange: ANSI Class 125.

DRAWINGS AND DIMENSIONS SUBJECT TO CHANGE WITHOUT NOTICE. DO NOT USE FOR CONSTRUCTION PURPOSES.
 CONTACT VAUGHAN FOR CERTIFIED CONSTRUCTION PRINTS.

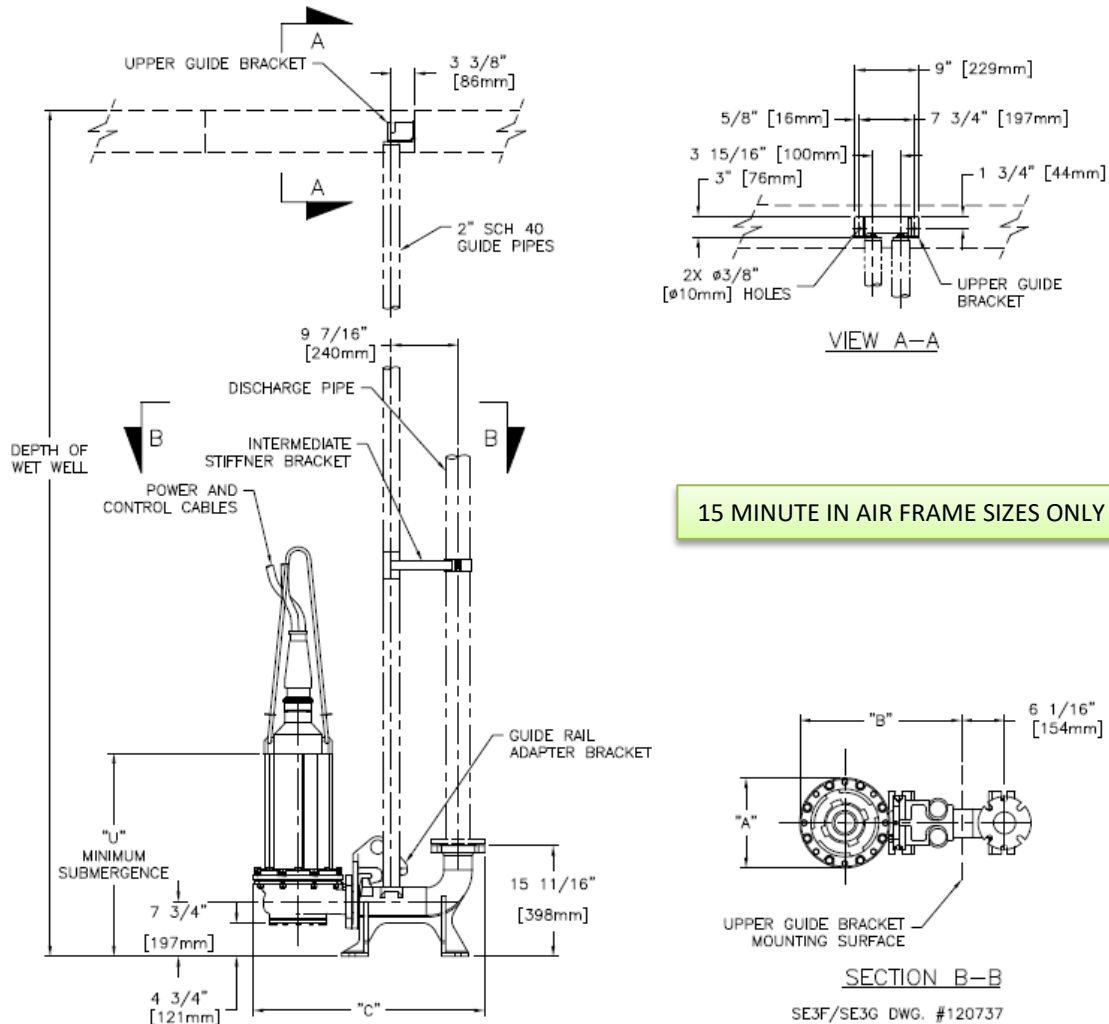

15 MINUTE IN AIR FRAME SIZES ONLY

Frame Size	U	A	B	C
180TY	29.00" 734 mm	12.75" 324 mm	23.00" 584 mm	32.75" 832 mm
210TY	35.38" 899 mm	15.25" 387 mm	24.40" 620 mm	34.13" 867 mm



VAUGHAN CO., INC.
 364 Monte Elma Road, Montesano, WA 98563
 Phone: 1-360-249-4042 / Fax: 1-360-249-6155
 Toll Free Phone (US only): 1-888-249-CHOP (2467)
 Website: www.chopperpumps.com
 Company E-mail: info@chopperpumps.com

For all current patents, see <https://www.chopperpumps.com/patents/>

**MADE IN THE
USA**

SPECIFICATIONS: STSE3F & STSE3G STAINLESS STEEL SUBMERSIBLE CHOPPER PUMPS

The submersible chopper pump shall be specifically designed to pump waste solids at heavy consistencies without plugging or dewatering of the solids. Materials shall be chopped and conditioned by the pump as an integral part of the pumping action. The pump must have demonstrated the ability to chop through and pump high concentrations of solids such as plastics, heavy rags, grease and hair balls, wood, paper products and stringy materials without plugging, both in tests and field applications. Pump shall be manufactured by Vaughan Co., Inc.

DETAILS OF CONSTRUCTION

- A. **Casing and Backplate:** The pump casing shall be of volute design, spiraling outward to the Class 125 flanged centerline discharge. Back pull-out design shall incorporate adjusting sleeves for accurate adjustment of impeller-to-cutter bar clearance. Casing & backplate shall be cast CD4MCu stainless steel with all water passages to be smooth, and free of blowholes and imperfections for good flow characteristics. Backplate shall include a sharpened cutter to cut against the rotating impeller pumpout for the purpose of removing fiber and debris from behind the impeller.
- B. **Impeller:** Shall be a 2 blade (3F) or 4 blade (3G) semi-open type with pump out vanes to reduce seal area pressure. Chopping of materials shall be accomplished by the action of the cupped and sharpened leading edges of the impeller blades moving across the stationary cutter bar at the intake openings, with a set clearance between the impeller and cutter bar of 0.015-0.025" (0.40-0.65 mm) cold. Impeller shall be cast CD4MCu stainless steel and dynamically balanced. The impeller shall be keyed to the shaft and shall have no axial adjustments and no set screws.
- C. **Cutter Bar:** Shall be recessed into the pump casing and shall contain at least 2 shear bars extending diametrically across the intake opening to within 0.010-0.030" (0.25-0.75 mm) of the rotating cutter nut tooth, for the purpose of preventing intake opening blockage and wrapping of debris at the shaft area and a sharpened cutter to cut against the rotating impeller for the purpose of removing fiber and debris from the front of the impeller. Cutter bar shall be CD4MCu stainless steel.
- D. **Cutter Nut:** The impeller shall be secured to the shaft using a cutter nut, designed to cut stringy materials and prevent binding using a raised, rotating cutter tooth. The cutter nut shall be cast CD4MCu stainless steel.
- E. **Upper Cutter:** Shall be threaded into the backplate behind the impeller, designed to cut against the pump-out vanes and the impeller hub, reducing and removing stringy materials from the mechanical seal area. Upper cutter shall be cast CD4MCu stainless steel. The upper cutter teeth are positioned as closely as possible to the center of shaft rotation to minimize cutting torque and nuisance motor tripping. The ratio of upper cutter cutting diameter to shaft diameter in the upper cutter area of the pump shall be 3.0 or less.
- F. **Shafting:** Pump shafting shall be 316 stainless steel. The pump shaft shall directly couple to the motor shaft, with a bolt and keyway.
- G. **Submersible Electric Motor:** The submersible motor shall be U/L or FM listed and suitable for Class I, Group C & D, Division I hazardous locations, rated at ___ HP, ___ RPM, ___ Volts, 50 or 60 Hertz and 3 phase, 1.15 service factor (1.0 for Continuous In-Air) with Class F insulation. Motor shall be equipped with tandem independently mounted mechanical seals in oil bath and with dual moisture sensing probes. Moisture probes must be connected to indicate water intrusion. The inner and outer seals shall be separated by an oil-filled chamber. The oil chamber shall act as a barrier to trap moisture and provide sufficient time for a planned shutdown. The oil shall also provide lubrication to the internal seal. The inner seal shall be a standard John Crane Type 21 or equal, with carbon rotating faces and ceramic stationary faces. The outer seal construction shall be designed for easy replacement. Outer mechanical seal shall be 316 stainless steel metal bellows type with tungsten carbide faces. Seal shall be positively driven by set screws. Elastomers shall be of Viton®. Motor shall include two normally closed automatic resetting thermostats connected in series and imbedded in adjoining phases. The thermostats must be connected per local, state, and/or the National Electric Code to maintain hazardous location rating and to disable motor starter if overheating occurs. Motor frame shall be cast iron, and all external hardware and shaft shall be stainless steel. Motor shall be sized for non-overloading conditions.
- H. **Stainless Steel Nameplate:** The stainless steel nameplate giving the manufacturer's model and serial number, rated capacity, head, speed and all pertinent data shall be mounted to a larger stainless steel plaque. Warning tags will be mounted to this same plaque. Plaque is to be fastened to wall or structure adjacent to pump.
- I. **Guide Rail System:** Provide a guide rail system consisting of two stainless steel guide rails (by others), cast stainless steel pump guide bracket, cast stainless steel discharge elbow with mounting feet and Class 125 flanges, 316 stainless steel upper guide rail mounting bracket, and 316 stainless steel intermediate guide rail stiffener bracket every 10 feet (3 m).
- J. **Optional Spark Proof Guide Rail System:** Provide a non-sparking guide rail system consisting of two stainless steel guide rails (by others), cast bronze pump guide bracket, cast stainless steel discharge elbow with mounting feet and Class 125 flanges, 316 stainless steel upper guide rail mounting bracket, and 316 stainless steel intermediate guide rail stiffener bracket every 10 feet (3 m). System design shall prevent spark ignition of explosive gases during pump installation and removal.
- K. **Surface Finish:** Sandblast.